

WAAS CH 60911 W16B	APP CRS 163°	Rwy Ldg TDZE Apt Elev	7000 570 608
--	------------------------	-----------------------------	---

RNAV (GPS) Y RWY 16R

SEATTLE PAINE FLD INTL (P.A.E.)


▼

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -5°C (23°F) or above 54°C (130°F). Circling Rwy 34R NA at night. DME/DME RNP-0.3 NA. For inop ALS, increase LNAV/VNAV Cats A/B visibility to RVR 5000.

MALSR

MISSED APPROACH: Climb to 1100 then climbing right turn to 2000 direct ECEPO and hold.

ATIS 128.65	SEATTLE APP CON 128.5 306.9	PAINE TOWER★ 132.95 (CTAF) 0 256.7	GND CON 121.8 339.8	UNICOM 122.95
-----------------------	---------------------------------------	--	-------------------------------	-------------------------

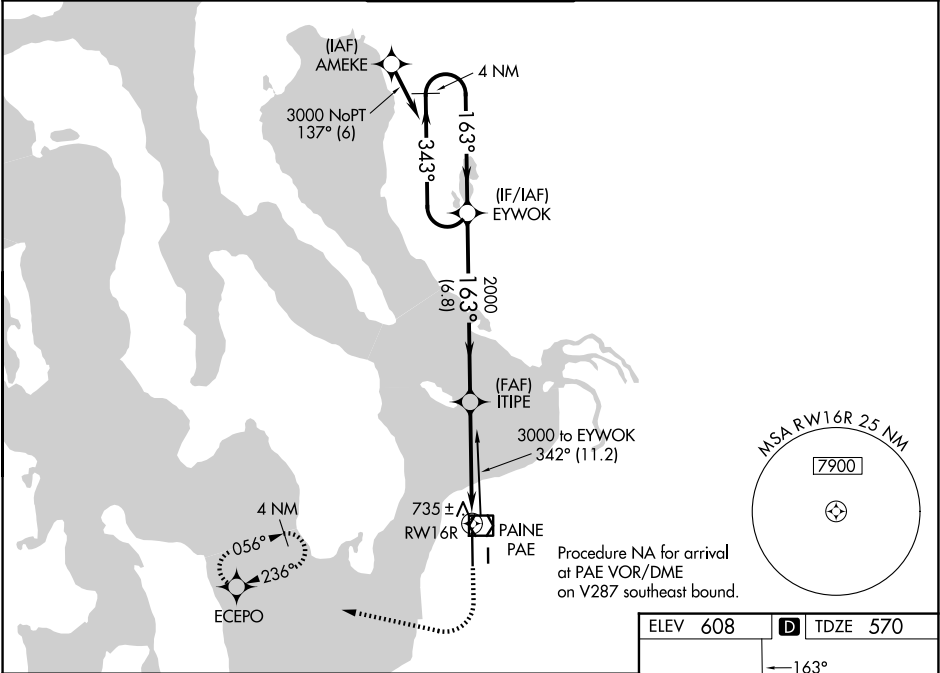

VGSI and descent angles not coincident

1100

2000

ECEPO

4 NM Holding Pattern

EYWOK

ITIPE

PAINE

RW16R

3000

343°

163°

163°

2000

6.8 NM

3.2 NM

1.1

GP 3.00°

TCH 57

*1.1 NM to RW16R

*LNAV only

CATEGORY	A	B	C	D
LPV DA	770/18	200 (200-½)	NA	
LNAV/VNAV DA	894/30	324 (300-⅝)	NA	
LNAV MDA	1000/24	430 (400-½)	NA	
CIRCLING	1100-1	492 (500-1)	NA	

ELEV 608

TDZE 570

163°

16R

TWR

7900

7000 X 150

34L

34R

TDZL/RCLS Rwy 16R

HIRL Rwy 16R-34L

REIL Rws 16L and 34R

MIRL Rwy 16L-34R