


APP CRS 212°	Rwy Ldg 11002 TDZE 2346 Apt Elev 2385
------------------------	--

RNAV (RNP) Z RWY 21
SPOKANE INTL (GEG)

RNP AR APCH. V For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 43°C. For inop ALS increase RNP 0.11 visibility all Cats to ¾, RNP 0.15 visibility all Cats to 1% and RNP 0.30 visibility all Cats to 1% .	ALSF-2 	MISSED APPROACH: Climb to 5000 on track 212° to IRUHO and on track 252° to GANGS and hold. *Missed approach requires minimum climb of 310 feet per NM to 3000.
---	---	--

ATIS 124.325 254.375	SPOKANE APP CON 123.75 282.25 (205°-025°) 133.35 263.0 (026°-204°)	SPOKANE TOWER 118.3 278.3	GND CON 121.9 348.6
--------------------------------	--	-------------------------------------	-------------------------------

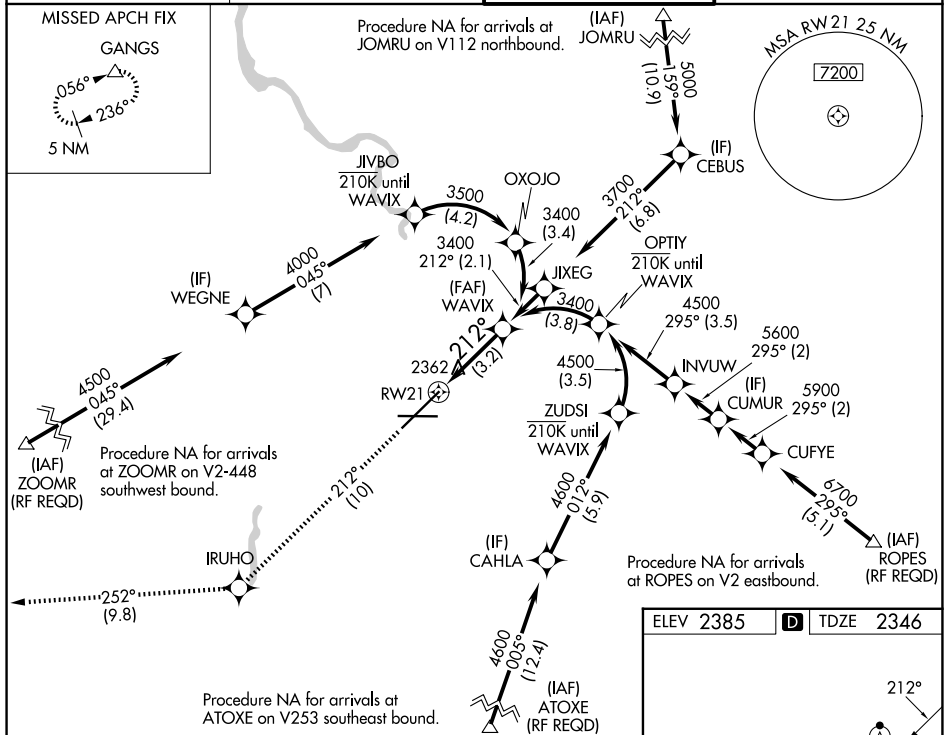

5000 ↑ tr 212°	IRUHO ✦	tr 252°	GANGS △	VGSI and RNAV glidepath not coincident (VGSI Angle 3.00°/TCH 73).	WAVIX 3400
See planview for multiple IF locations.					
CATEGORY	A	B	C	D	
RNP 0.11 DA*	2596/24		250 (300-½)		
RNP 0.15 DA	2699/30		353 (400-⅝)		
RNP 0.30 DA	2752/45		406 (400-⅞)		
AUTHORIZATION REQUIRED					

