

WAAS CH 70615 W27A	APP CRS 275°	Rwy Ldg TDZE Apt Elev	6520 974 981
--	------------------------	-----------------------------	---

RNAV (GPS) RWY 27L

OAKLAND COUNTY INTL (PTK)

RNP APCH - GPS.


▼

⚠

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -16°C or above 54°C. Baro-VNAV and VDP NA when using DET altimeter setting. Circling Rwy 9L, 36 NA at night. When local altimeter setting not received, use DET altimeter setting: increase LPV DA to 1280 feet and all visibilities ½ SM; increase LNAV/VNAV DA to 1566 feet; increase all MDAs 120 feet and LNAV visibility Cat C ¾ SM, LNAV visibility Cat D ¼ SM, and Circling visibility Cats C/D ½ SM.

MISSED APPROACH:
Climb to 3000 direct
EDESE and hold.

ATIS 125.025	DETROIT APP CON 132.35 284.0	PONTIAC TOWER ★ 120.5 (CTAF) 0	GND CON 121.9	UNICOM 122.95
------------------------	--	--	-------------------------	-------------------------

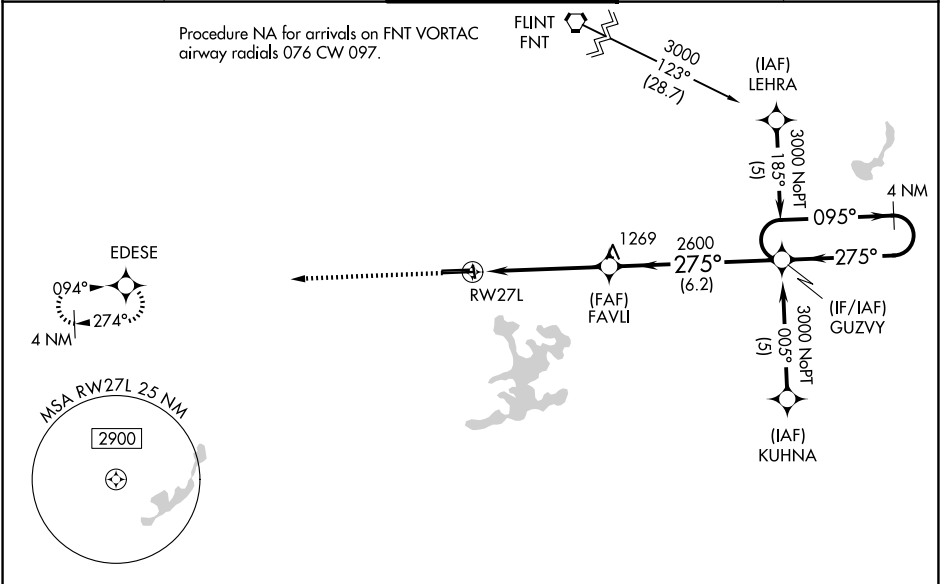

ELEV 981

D

TDZE 974

↑ 3000

EDESE

VGSI and RNAV glidepath not coincident
(VGSI Angle 3.00/TCH 42).

4 NM Holding Pattern

275°

FAVLI

2600

095° →

← 275°

3000

GP 3.00°

TCH 47

1.4 NM to RWY 27L

1.4

3.5 NM

6.2 NM

CATEGORY	A	B	C	D
LPV DA	1174-3¼ 200 (200-¾)			
LNAV/VNAV DA	1460-1¾ 486 (500-1¾)			
LNAV MDA	1460-1	486 (500-1)	1460-1¾ 486 (500-1¾)	1460-1½ 486 (500-1½)
CIRCLING	1500-1 519 (600-1)	1540-1 559 (600-1)	1640-1¾ 659 (700-1¾)	1640-2 659 (700-2)