

JACKSONVILLE, FLORIDA

HI-ILS Z or LOC Z RWY 8

LOC I-JAX
110.7

APCH CRS
077°

Rwy Idg **10,000**
TDZE **30**
Arpt Elev **30**

[USAF]


JACKSONVILLE INTL (KJAX)

DME required. RADAR required for procedure entry.

ALSIF-2
A

MISSED APPROACH: Climb to 1000 then climbing left turn to 4000 on heading 250° and on CRG R-316 to HAMOC/CRG 23 DME and hold, continue climb-in-hold to 4000.

ATIS 125.85	APP CON 119.0 269.9	TOWER 118.3 317.7	GND CON 121.9 348.6	CLNC DEL 119.5 290.275
-----------------------	-------------------------------	-----------------------------	-------------------------------	----------------------------------

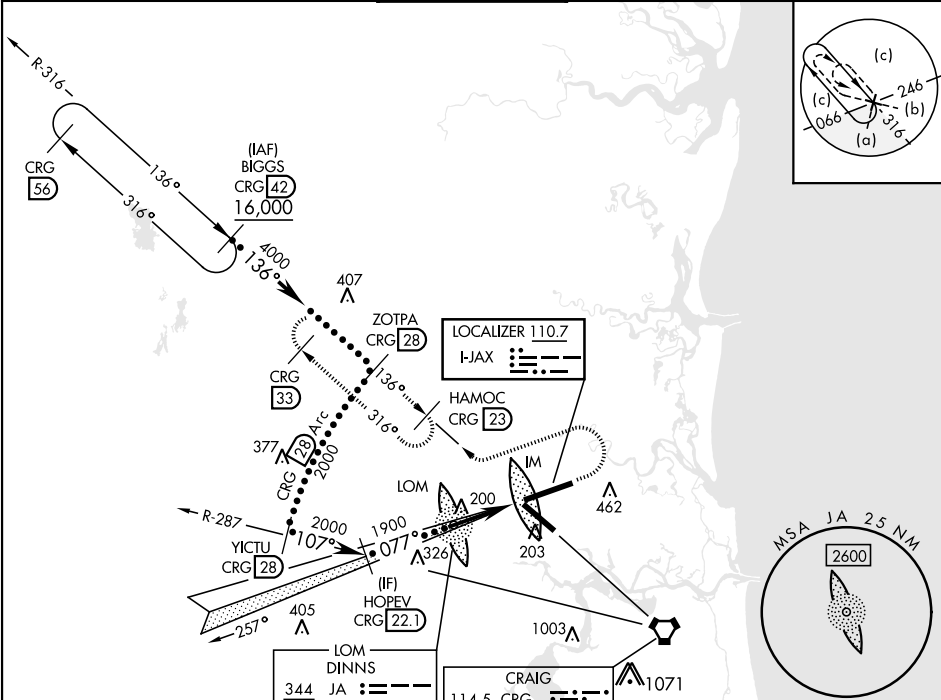

EMERG SAFE ALT 100 NM 2600			ELEV 30		TDZE 30	
VGSi and ILS glidepath not coincident (VGSi Angle 3.00/TCH 70).			1000	4000	CRG R-316	HAMOC CRG 23
HOPEV 22.1			2000	1900	1861	IM
GS 3.00° TCH 55			077°	1900	1861	IM
			5.5 NM			
			0.1			
CATEGORY	C	D	E			
S-ILS 8 *	230/18	200	(200-½)			
S-LOC 8 **	480/45	450	(500-¾)			
CIRCLING	580-1½	580-2	760-2½			
	550 (600-1½)	550 (600-2)	730 (800-2½)			

HI-ILS Z or LOC Z RWY 8