RNAV (RNP) Z RWY 3

CHARLESTON AFB/INTL (CHS)


APP CRS	Rwy Ldg	7000
031°	TDZE	35
	Apt Elev	46

RNP AR APCH.

For uncompensated Baro-VNAV systems, procedure NA below -5°C or above 54°C.


MISSED APPROACH: Climb to 3000 direct BAMDE and hold, continue to climb-in-hold to 3000.

D-ATIS	CHARLESTON APP CON	CHARLESTON TOWER	GND CON
124.75	120.7 306.925	126.0 239.0	121.9 348.6

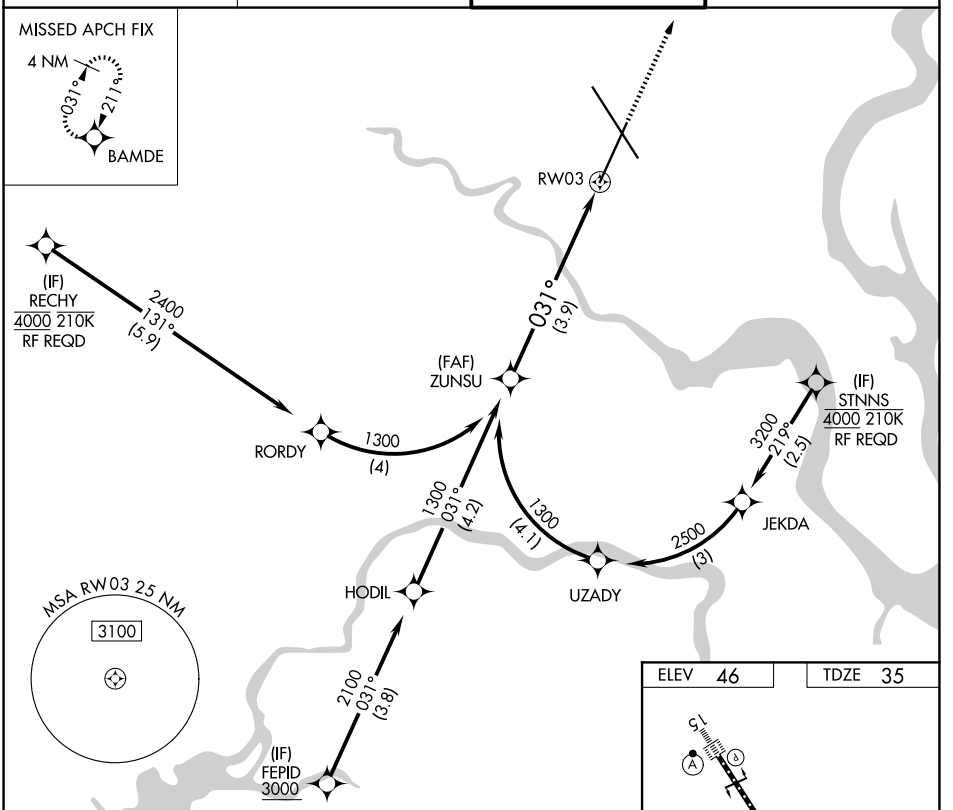

See planview for multiple IF locations.


3000 BAMDE

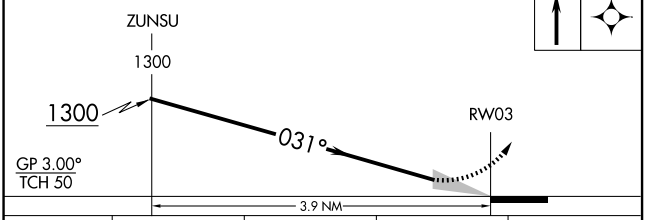

CATEGORY	A	B	C	D
RNP 0.20 DA		285-¾	250 (300-¾)	
RNP 0.30 DA		429-1⅛	394 (400-1⅛)	

AUTHORIZATION REQUIRED

ELEV 46 TDZE 35

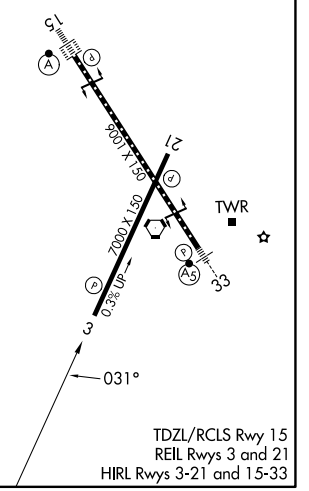

TDZL/RCLS Rwy 15
REIL Rwys 3 and 21
HIRL Rwys 3-21 and 15-33

SE-2, 29 OCT 2026 to 26 NOV 2026
SE-2, 29 OCT 2026 to 26 NOV 2026